

# 2015 drinking water quality report

PLAINVIEW WATER DISTRICT  
PUBLIC WATER SUPPLY IDENTIFICATION NO. 2902845

## ANNUAL WATER SUPPLY REPORT

APRIL 2016

The Plainview Water District is pleased to present this year's Water Quality Report. The report is required to be delivered to all residents of our District in compliance with Federal and State regulations. This report is designed to inform you about the quality of water and services we deliver to you every day. Our constant goal is to provide you with a safe and dependable supply of drinking water. We also want you to understand the efforts we make to continually improve the water treatment process and protect our water supply. The Board of Water Commissioners who live in the community and District employees are committed to ensuring that you and your family receive the highest quality water.


## SOURCE OF OUR WATER

The source of water for the District is groundwater pumped from 12 wells located throughout the community that are drilled into the Magothy aquifer beneath Long Island, as shown on the adjacent figure. Generally, the water quality of the aquifer is good-to-excellent, although there are localized areas of contamination.

In order to ensure that our tap water is safe to drink, the State and the EPA prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Health Department's and the FDA's regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

The population served by the Plainview Water District during 2015 was 34,000. The total amount of water withdrawn from the aquifer in 2015 was 1.91 billion gallons, of which approximately 96.3 percent was billed directly to consumers.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include: microbial contaminants; inorganic contaminants; pesticides and herbicides; organic chemical contaminants; and radioactive contaminants.

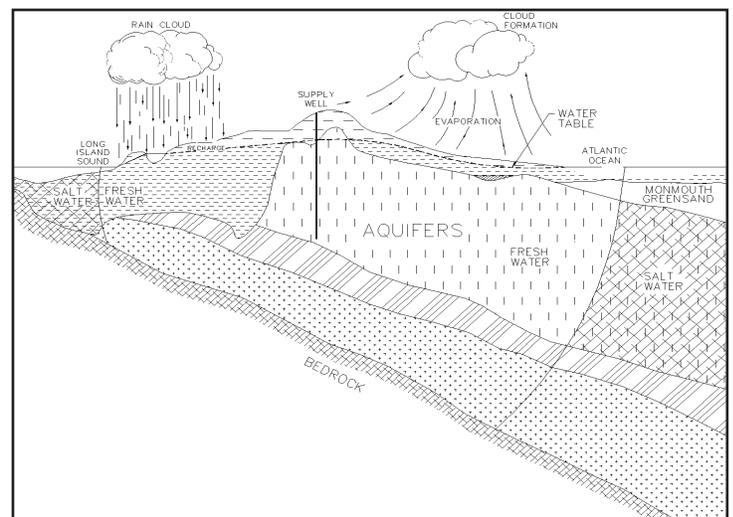

THE LONG ISLAND AQUIFER SYSTEM

In order to ensure that tap water is safe to drink, the State and the EPA prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Health Department's and the FDA's regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

## WATER TREATMENT

The Plainview Water District provides treatment at all wells to improve the quality of the water pumped prior to distribution to the consumer. The pH of the pumped water is adjusted upward to reduce corrosive action between the water and water mains and in-house plumbing by the addition of lime. The pumped water is also chlorinated to a minimum chlorine residual of 0.2 milligrams per liter (mg/l) to protect against the growth of bacteria within the distribution system. At Plant No. 4, an individual well with high nitrate levels is blended with another well with low nitrate levels to meet the nitrate limit of 10 mg/l. Carbon adsorption treatment systems are available for Well Nos. 1-2 and 3-2 for the removal of volatile organic compounds. Well Nos. 2-1, 4-2, 4-3, 5-1, 5-2, 5-3, 5-4, 7-1 and 7-2 are presently treated by air stripping treatment systems for the removal of volatile organic compounds.

## WATER CONSERVATION MEASURES

The underground water system of Long Island has more than enough water for present water demands. However, saving water will ensure that our future generations will always have a safe and abundant water supply.

In 2015, the Plainview Water District continued to implement a water conservation program in order to minimize any unnecessary water use. The pumpage for 2015 was 2.1 percent more than in 2014. This can most likely be attributed to the hotter and drier weather in the summer of 2015, as well as the water conservation program implemented by the District.

Residents of the District can also implement their own water conservation measures such as retrofitting plumbing fixtures with flow restrictors, modifying automatic lawn sprinklers to include rain sensors, repairing leaks in the home, installing water conservation fixtures/applications and maintaining a daily awareness of water conservation in their personal habits. In addition, the Nassau County Lawn Sprinkler Regulations are still in effect. Besides protecting our precious underground water supply, water conservation will produce a cost savings to the consumer in terms of both water and energy bills (hot water).

### COST OF WATER

The District utilizes a step billing schedule as shown with the average consumer being billed at \$1.99 per 1,000 gallons.

## WATER QUALITY

In accordance with State regulations, the Plainview Water District routinely monitors your drinking water for numerous parameters. We test your drinking water for coliform bacteria, turbidity, inorganic contaminants, lead and copper, nitrate, volatile organic contaminants, total trihalomethanes and synthetic organic contaminants. Over 135 separate parameters are tested for in each of our wells numerous times per year. The table presented on page 3 depicts which parameters or contaminants were detected in the water supply. It should be noted that many of these parameters are naturally found in all Long Island drinking water and do not pose any adverse health effects.

### QUARTERLY WATER RATES - 2016

Consumption (gallons)	Charges
Up to 10,000	\$14.00 minimum
10,000 - 30,000	\$1.99/thousand gallons
30,000 - 50,000	\$2.40/thousand gallons
50,000 - 70,000	\$2.70/thousand gallons
Over 70,000	\$3.00/thousand gallons

## CONTACTS FOR ADDITIONAL INFORMATION

We are pleased to report that our drinking water is safe and meets all Federal and State requirements. If you have any questions about this report or the Plainview Water District, please contact Water District Superintendent Richard Tobin at (516) 931-6469 or the Nassau County Department of Health at (516) 227-9692. We want our valued customers to be informed about our water system. If you want to learn more, please attend any of our regularly scheduled meetings. They are normally held every Tuesday at 5:30 p.m. at the Water District office, located at 10 Manetto Hill Road. Updated meeting schedules are posted on a monthly basis at the Water District office, Plainview Public Library and on the District website located at <http://www.plainviewwater.org>.

The Plainview District routinely monitors for different parameters and possible contaminants in your drinking water as required by Federal and State laws. All drinking water, including bottled drinking water, may be reasonably expected to contain at least small amounts of some impurities. It's important to remember that the presence of these impurities does not necessarily pose a health risk. For more information on contamination and potential health risks, please contact the USEPA Safe Drinking Water Hotline at 1-800-426-4791.

## NEW YORK STATE MANDATORY HEALTH ADVISORY

Water from the Plainview Water District has elevated levels of nitrates, but below the maximum contaminant level of 10.0 parts per million (ppm). Nitrate in drinking water at levels above 10 ppm is a health risk for infants of less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. The source of the nitrates is the nitrogen in fertilizers and from on-site septic systems. If you are caring for an infant you should ask advice from your health care provider.

Some people may be more vulnerable to disease causing microorganisms or pathogens in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. [EPA/CDC guidelines on appropriate means to lessen the risk to infection by Cryptosporidium, Giardia and other microbial pathogens are available from the Safe Drinking Water Hotline (800-426-4791).]

During 2014, the District collected 30 samples for lead and copper. The next round of samples will occur in 2017. If present, elevated levels of lead can cause serious health problems, especially for pregnant women, infants, and young children. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. Plainview Water District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or at <http://www.epa.gov/safewater/lead>.

# 2015 DRINKING WATER QUALITY REPORT - TABLE OF DETECTED PARAMETERS

Contaminants	Violation (Yes/No)	Date of Sample	Level Detected (Maximum Range)	Unit Measurement	MCLG	Regulatory Limit (MCL or AL)	Likely Source of Contaminant
<b>Inorganic Contaminants</b>							
Copper	No	September 2014	ND - 0.19 0.027 <sup>(1)</sup>	mg/l	1.3	AL = 1.3	Corrosion of household plumbing systems; Erosion of natural deposits
Lead	No	September 2014	ND - 1.0 ND <sup>(1)</sup>	ug/l	0	AL = 15	Corrosion of household plumbing systems; Erosion of natural deposits
Sodium	No	01/15/15	4.0 - 11.0	mg/l	n/a	None <sup>(2)</sup>	Naturally occurring
Calcium	No	01/15/15	1.5 - 8.9	mg/l	None	None	Naturally occurring
Chloride	No	05/08/15	5.6 - 16.8	mg/l	n/a	MCL = 250	Naturally occurring
Barium	No	07/22/15	ND - 0.02	mg/l	n/a	MCL = 2.0	Naturally occurring
Iron	Yes	06/04/15	ND - 200	ug/l	n/a	MCL = 300	Naturally occurring
Nitrate	No	09/11/15	1.2 - 8.1	mg/l	10	MCL = 10	Runoff from fertilizer and leaching from septic tanks and sewage
Manganese	No	01/15/15	ND - 2.0	ug/l	n/a	MCL = 300	Naturally occurring
Magnesium	No	01/15/15	0.7 - 2.5	mg/l	n/a	None	Naturally occurring
Nickel	No	07/22/15	ND - 4.0	ug/l	n/a	MCL = 100	Naturally occurring
Zinc	No	06/04/15	ND - 0.03	mg/l	n/a	MCL = 5.0	Naturally occurring
<b>Bacteriological</b>							
Total Coliform	No	10/27/15	1 Positive out of 40 samples	Positive or Negative	n/a	MCL = Positive results in more than 5% of the monthly samples	Commonly found in the environment
<b>Volatile Organic Contaminants</b>							
1,1,1-Trichloroethane	No	08/10/15	ND - 2.2	ug/l	0	MCL = 5	Industrial/Commercial discharge
Tetrachloroethene	No	09/29/15	ND - 2.3	ug/l	0	MCL = 5	Industrial/Commercial discharge
Trichloroethene	No	06/25/15	ND - 2.3	ug/l	0	MCL = 5	Industrial/Commercial discharge
cis-1,2-Dichloroethene	No	10/05/15	ND - 2.1	ug/l	0	MCL = 5	Industrial/Commercial discharge
1,1-Dichloroethene	No	12/22/15	ND - 2.1	ug/l	0	MCL = 5	Industrial/Commercial discharge
1,1-Dichloroethane	No	04/21/15	ND - 3.0	ug/l	0	MCL = 5	Industrial/Commercial discharge
<b>Disinfection By-Products</b>							
Total Trihalomethanes	No	09/23/15	ND - 5.9	ug/l	0	MCL = 80	Disinfection By-Products
Haloacetic Acid (HAA5)	No	05/17/14	ND - 2.9	ug/l	0	MCL = 60	Disinfection By-Products
<b>Radionuclides</b>							
Gross Alpha	No	08/18/15	0.46 - 2.74	pCi/L	n/a	MCL = 15	Naturally occurring
Gross Beta	No	10/27/15	-0.9 - 3.44	pCi/L	n/a	MCL = 50	Naturally occurring
Combined Radium 226 & 228	No	12/17/15	1.7 - 2.15	pCi/L	n/a	MCL = 5 <sup>(3)</sup>	Naturally occurring
<b>Unregulated Contaminants</b>							
Perchlorate	No	12/08/14	ND - 10.4	ug/l	0	AL = 18 <sup>(4)</sup>	Fertilizer
<b>Unregulated Contaminant Monitoring Rule<sup>(5)</sup></b>							
1,4-Dioxane	No	12/17/15	0.59 - 2.8	ug/l	0	MCL = 50	Industrial discharge
Chromium	No	05/14/14	ND - 0.5	ug/l	0	MCL = 100	Natural deposits
Cobalt	No	05/14/14	ND - 5.2	ug/l	0	No MCL	Naturally occurring
Strontium	No	11/05/14	11.0 - 63.2	ug/l	0	No MCL	Naturally occurring
Vanadium	No	05/14/14	ND - 0.3	ug/l	0	No MCL	Naturally occurring
Hexavalent Chromium	No	05/14/14	ND - 0.18	ug/l	0	MCL = 100	Natural deposits
Chlorate	No	11/05/14	ND - 63.0	ug/l	0	No MCL	Naturally occurring

**Definitions:**

**Maximum Contaminant Level (MCL).** - The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible.  
**Maximum Contaminant Level Goal (MCLG).** - The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.  
**Action Level (AL).** - The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.  
**Milligrams per liter (mg/L).** - Corresponds to one part of liquid in one million parts of liquid (parts per million - ppm).  
**Micrograms per liter (ug/L).** - Corresponds to one part of liquid in one billion parts of liquid (parts per billion - ppb).  
**Non-Detects (ND).** - Laboratory analysis indicates that the constituent is not present.  
**pCi/L.** - pico Curies per Liter is a measure of radioactivity in water.

- (1) - During 2014, we collected and analyzed 30 samples for lead and copper. The 90% percentile level is presented in the table. The action level for lead was not exceeded at any site tested. The action level for copper was not exceeded at any site. The next round of sampling and testing will occur in 2017.
- (2) - No MCL has been established for sodium. However, 20 mg/l is a recommended guideline for people on high restricted sodium diets and 270 mg/l for those on moderate sodium diets.
- (3) - MCL for Radium is for Radium 226 and Radium 228 combined.
- (4) - Perchlorate is an unregulated contaminant. However, the NYS Dept. of Health has established an action level of 18.0 ug/l.
- (5) - UCMR3 - Unregulated Contaminant Monitoring Rule 3 is a Federal water quality sampling program where water suppliers sample and test their source water for 1 year. Results will be used by the USEPA to determine if the contaminants need to be regulated in the future.

## SOURCE WATER ASSESSMENT

The NYSDOH, with assistance from the local health department, has completed a source water assessment for this system, based on available information. Possible and actual environmental threats to this drinking water source were evaluated. The source water assessment includes a susceptibility rating based on the risk posed by potential source of contamination and how rapidly contaminants can move through the subsurface to the wells. The susceptibility of a water supply well to contamination is dependent upon both the presence of potential sources of contamination within the well's contributing area and the likelihood that the contaminant can travel through the environment to reach the well. The susceptibility rating is an estimate of the potential for contamination of the source water, it does not mean that the water delivered to consumers is, or will become contaminated. Please refer to section "Water Quality" for a list of the contaminants that have been detected. The source water assessments provide resource managers with additional information for protecting source waters into the future.

Drinking water is derived from 12 wells. The source water assessment has rated most of the wells as having a very high susceptibility to industrial solvents and a high susceptibility to nitrates. The elevated susceptibility to industrial solvents is due primarily to point sources of contamination related to transportation routes and commercial/industrial facilities and related activities in the assessment area. The elevated susceptibility to nitrates is due to unsewered residential land use and related practices, such as fertilizing lawns, in portions of the assessment area.

A copy of the assessment, including a map of the assessment area, can be reviewed by contacting the District Office.

It must be noted that assessment results indicating an elevated susceptibility does not imply supply well contamination or inevitability. Susceptibility correlates to contamination prevalence and sensitivity. Furthermore, a supply well that has a medium to high susceptibility demonstrates the need for continuing management of potential contamination sources. It is important to note that there is a distinct difference between raw source water and actual finished (treated) water delivered to the customers. Water suppliers are obligated by strict federal, state and local laws and regulations to provide water that is safe to drink. Treatment is required when water quality results indicate the presence of contaminants at or above an established maximum contaminant level.

The Plainview Water District conducts over 14,000 water quality tests throughout the year, testing for over 130 different contaminants which have been undetected in our water supply, including:

Arsenic	Dicamba (SOC)	1,1-Dichloropropene
Cadmium	Pentachlorophenol (SOC)	1,2-Dichloroethane
Chromium	Hexachlorocyclopentadiene (SOC)	Dibromomethane
Fluoride	bis(2-Ethylhexyl)adipate (SOC)	Trans-1,3-Dichloropropene
Mercury	bis(2-Ethylhexyl)phthalate (SOC)	cis-1,3-Dichloropropene
Selenium	Hexachlorobenzene (SOC)	1,1,2-Trichloroethane
Silver	Benzo(A)Pyrene (SOC)	1,3-Dichloropropane
Color	Aldicarb Sulfone (SOC)	Chlorobenzene
Turbidity	Aldicarb/sulfoxide (SOC)	1,1,1,2-Tetrachloroethane
Odor	Aldicarb (SOC)	Bromobenzene
Ammonia	Total Aldicarb (SOC)	1,1,2,2-Tetrachloroethane
Nitrite	Oxamyl (SOC)	1,2,3-Trichloropropane
Detergents (MBAS)	Methomyl (SOC)	2-Chlorotoluene
Free Cyanide	3-Hydroxycarbofuran (SOC)	4-Chlorotoluene
Antimony	Carbofuran (SOC)	1,2-Dichlorobenzene
Beryllium	Carbaryl (SOC)	1,3-Dichlorobenzene
Thallium	Glyphosate (SOC)	1,4-Dichlorobenzene
Lindane (SOC)	Diquat (SOC)	1,24-Trichlorobenzene
Heptachlor (SOC)	Endothall (SOC)	Hexachlorobutadiene
Aldrin (SOC)	1,2-Dibromoethane (EDB) (SOC)	1,2,3-Trichlorobenzene
Heptachloro Epoxide (SOC)	1,2-Dibromo-3-Chl.Propane (SOC)	Benzene
Dieldrin (SOC)	Dioxin (SOC)	Ethylbenzene
Endrin (SOC)	Chloroacetic Acid	M,P-Xylene
Methoxychlor (SOC)	Bromoacetic Acid	O-Xylene
Toxaphene (SOC)	Dichloroacetic Acid	Styrene
Chlordane (SOC)	Trichloroacetic Acid	Isopropylbenzene (Cumene)
Total PCBs (SOC)	Dibromoacetic Acid	N-Propylbenzene
Propachlor (SOC)	Total Haloacetic Acid	1,3,5-Trimethylbenzene
Alachlor (SOC)	Radium 226	Tert-Butylbenzene
Simazine (SOC)	Dichlorodifluoromethane	1,2,4-Trimethylbenzene
Atrazine (SOC)	Chloromethane	Sec-Butylbenzene
Metolachlor (SOC)	Vinyl Chloride	4-Isopropyltoluene (P-Cumene)
Metribuzin (SOC)	Bromomethane	N-Butylbenzene
Butachlor (SOC)	Chloroethane	Methyl Tert. Butyl Ether (MTBE)
2,4-D (SOC)	Chlorodifluoromethane	
2,4,5-TP (Silvex) (SOC)	Methylene Chloride	
Dinoseb (SOC)	Trans-1,2-Dichloroethene	
Dalapon (SOC)	2,2-Dichloropropane	
Picloram (SOC)	Bromochloromethane	

*Note: (SOC) - Synthetic Organic Contaminant*

Copies of the Supplemental Data Package, which includes the water quality data for each of our supply wells utilized during 2015, are available at the Plainview Water District office which is located at 10 Manetto Hill Road, Plainview, New York, the local Public Library and the Water District website located at <http://www.plainviewwater.org>.

We, at the Plainview Water District, work diligently to provide top quality water to every tap throughout the community. We ask that all our customers help us protect our water resources, which are the heart of our community, our way of life and our children's future.

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (mg/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(1)</sup>		WELL NO. 1-2 N-04096 <sup>(2)</sup>		WELL NO. 2-1 N-07526 <sup>(1)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>INORGANIC</b>												
ARSENIC	10.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
BARIUM	2.0 mg/l	0.2 mg/l	0.004	0.004	0.02/0.01	0.02/0.01	0.01	0.01			0.01	0.01
CADMIUM	5.0 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CHROMIUM	0.10 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
COPPER	[1.3] mg/l	0.02 mg/l	ND	ND	0.03/ND	0.03/ND	ND	ND			0.02	0.02
FLUORIDE	2.2 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
LEAD	[15.0] ug/l	1.0 ug/l	ND	ND	1.1/ND	1.1/ND	ND	ND			1.5	1.5
MERCURY	2.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
LANGLIER SATURATION INDEX	None	None	-3.97	-3.97	-3.39/-4.47	-3.39/-4.47	-4.17	-4.17			-3.48	-3.48
SELENIUM	50 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
SILVER	0.1 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
SODIUM	**20/270 mg/l	0.2 mg/l	6.5	6.5	9.1/8.9	9.1/8.9	7.1	7.1			10.0	10.0
ZINC	5.0 mg/l	0.02 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
COLOR	15 Units	5 Units	ND	ND	ND	ND	ND	ND			ND	ND
TURBIDITY	5 Units	1 Unit	ND	ND	ND	ND	ND	ND			ND	ND
ODOR	3 Units	0 Units	ND	ND	ND	ND	ND	ND			ND	ND
IRON	0.3 mg/l	0.02 mg/l	ND	ND	ND/**0.4	ND/**0.4	ND	ND			ND	ND
MANGANESE	0.3 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
AMMONIA	None	0.1 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
NITRITE	1.0 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
NITRATE	10.0 mg/l	0.1 mg/l	5.4 <sup>(12)</sup>	4.4	7.2 <sup>(1)</sup> /10.1 <sup>(3)</sup>	7.2/10.0	6.0 <sup>(13)</sup> /5.1 <sup>(12)</sup>	4.7/4.5			7.9 <sup>(8)</sup> /8.1 <sup>(7)</sup>	7.2/7.6
CHLORIDE	250 mg/l	1.0 mg/l	9.1	9.1	13.5/12.5	13.5/12.5	10.1	10.1			16.8	16.8
TOTAL HARDNESS	None	1.0 mg/l	18.5	18.5	30.7/34.4	30.7/34.4	17.5	17.5			29.2	29.2
TOTAL ALKALINITY	None	0 mg/l	2.6	2.6	6.8/ND	6.8/ND	1.6	1.6			6.2	6.2
pH (BEFORE TREATMENT)	None	None	6.2	6.2	6.2/6.2	6.2/6.2	6.2	6.2			6.2	6.2
TOTAL DISSOLVED SOLIDS	None	5.0 mg/l	54.0	54.0	81.0/92.0	81.0/92.0	26.0	26.0			55.0	55.0
DETERGENTS (MBAS)	None	0.08 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
SULFATE	250 mg/l	5.0 mg/l	ND	ND	ND	ND	ND	ND			ND	ND
FREE CYANIDE	200 ug/l	10.0 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
ANTIMONY	6.0 ug/l	5.9 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BERYLLIUM	4.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CALCIUM	None	1.0 mg/l	5.2	5.2	8.7/10.0	8.7/10.0	4.7	4.7			7.8	7.8
MAGNESIUM	None	1.0 mg/l	1.3	1.3	2.2/2.2	2.2/2.2	1.4	1.4			2.4	2.4
NICKEL	0.10 mg/l	0.04 mg/l	0.002	0.002	0.01/0.002	0.01/0.002	0.003	0.003			ND	ND
THALLIUM	2.0 ug/l	0.3 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
PERCHLORATE	18 ug/l	1.0 ug/l	3.0 <sup>(12)</sup>	1.5	1.3/ND	1.3/ND	3.1 <sup>(13)</sup> /2.8 <sup>(12)</sup>	2.3/2.3			4.2 <sup>(6)</sup> /4.8 <sup>(5)</sup>	3.5/3.8

CONT. - CONTAMINANT

ND - NOT DETECTED

\*\* - 20 mg/l IS THE LIMIT FOR PEOPLE ON HIGHLY RESTRICTED SODIUM DIETS AND 270 mg/l FOR THOSE ON MODERATELY RESTRICTED SODIUM DIETS

\*\*\* - EXCEEDS NEW YORK STATE/USEPA LIMITS FOR POTABLE WATER

[ ] - USEPA/NYS DH ACTION LEVEL

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (mg/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-08077 <sup>(1)</sup>		WELL NO. 4-3 N-12535 <sup>(1)</sup>		WELL NO. 5-1 N-06956 <sup>(1)</sup>		WELL NO. 5-2 N-07421 <sup>(1)</sup>		WELL NO. 5-3 N-08054 <sup>(1)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>INORGANIC</b>												
ARSENIC	10.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BARIUM	2.0 mg/l	0.2 mg/l	0.02	0.02	0.004	0.004	0.007	0.007	0.02	0.02	0.008	0.008
CADMIUM	5.0 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHROMIUM	0.10 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
COPPER	[1.3] mg/l	0.02 mg/l	0.3	0.3	ND	ND	ND	ND	ND	ND	0.1	0.1
FLUORIDE	2.2 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
LEAD	[15.0] ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	1.3	1.3	ND	ND
MERCURY	2.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
LANGLIER SATURATION INDEX	None	None	-4.04	-4.04	-4.13	-4.13	-4.93	-4.93	-4.77	-4.77	-4.78	-4.78
SELENIUM	50 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
SILVER	0.1 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
SODIUM	**20/270 mg/l	0.2 mg/l	11.0	11.0	9.1	9.1	7.0	7.0	7.8	7.8	4.1	4.1
ZINC	5.0 mg/l	0.02 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
COLOR	15 Units	5 Units	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TURBIDITY	5 Units	1 Unit	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
ODOR	3 Units	0 Units	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
IRON	0.3 mg/l	0.02 mg/l	0.1	0.1	ND	ND	0.02	0.02	0.2	0.2	ND	ND
MANGANESE	0.3 mg/l	0.01 mg/l	0.02	0.02	ND	ND	ND	ND	0.02	0.02	ND	ND
AMMONIA	None	0.1 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
NITRITE	1.0 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	0.9 <sup>(2)</sup>	0.4
NITRATE	10.0 mg/l	0.1 mg/l	***14.7 <sup>(24)</sup>	8.1	7.8 <sup>(24)</sup>	6.4	3.8 <sup>(4)</sup>	3.4	6.5 <sup>(9)</sup>	5.4	6.1 <sup>(9)</sup>	3.1
CHLORIDE	250 mg/l	1.0 mg/l	11.2	11.2	10.9	10.9	8.8	8.8	14.4	14.4	8.0	8.0
TOTAL HARDNESS	None	1.0 mg/l	32.5	32.5	20.6	20.6	13.5	13.5	20.1	20.1	8.5	8.5
TOTAL ALKALINITY	None	0 mg/l	2.4	2.4	3.4	3.4	ND	ND	1.1	1.1	1.8 <sup>(2)</sup>	1.5
pH (BEFORE TREATMENT)	None	None	6.0	6.0	6.0	6.0	6.2	6.2	6.2 <sup>(2)</sup>	6.2	6.2 <sup>(2)</sup>	6.2
TOTAL DISSOLVED SOLIDS	None	5.0 mg/l	33.0	33.0	57.0	57.0	28.0	28.0	64.0 <sup>(2)</sup>	61.5	33.0 <sup>(2)</sup>	22.5
DETERGENTS (MBAS)	None	0.08 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
SULFATE	250 mg/l	5.0 mg/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
FREE CYANIDE	200 ug/l	10.0 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
ANTIMONY	6.0 ug/l	5.9 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BERYLLIUM	4.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CALCIUM	None	1.0 mg/l	8.9	8.9	5.4	5.4	3.4	3.4	5.0	5.0	2.2	2.2
MAGNESIUM	None	1.0 mg/l	2.5	2.5	1.7	1.7	1.2	1.2	1.8	1.8	0.7	0.7
NICKEL	0.10 mg/l	0.04 mg/l	0.001	0.001	0.001	0.001	0.003	0.003	0.004	0.004	0.003	0.003
THALLIUM	2.0 ug/l	0.3 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
PERCHLORATE	18 ug/l	1.0 ug/l	9.6 <sup>(12)</sup>	6.6	7.8 <sup>(12)</sup>	5.8	4.9 <sup>(3)</sup>	4.8	10.4 <sup>(7)</sup>	9.3	5.4 <sup>(7)</sup>	3.4

ND - NOT DETECTED **Note:** Well 4-2 is blended with low nitrate Well 4-3 to provide water with nitrate levels below 10 ppm.

\*\*\* - EXCEEDS NEW YORK STATE/USEPA LIMITS FOR POTABLE WATER

\*\* - 20 mg/l IS THE LIMIT FOR PEOPLE ON HIGHLY RESTRICTED SODIUM DIETS AND 270 mg/l FOR THOSE ON MODERATELY RESTRICTED SODIUM DIETS

[ ] - USEPA/NYS DH ACTION LEVEL

† - WELL NO. 4-2 IS BLENDED WITH WELL NO. 4-3 TO REDUCE NITRATE LEVEL OF WATER

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

**PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)**

PARAMETERS (mg/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595 <sup>(1)</sup>		WELL NO. 7-1 N-12670 <sup>(1)</sup>		WELL NO. 7-2 N-13923 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>INORGANIC</b>								
ARSENIC	10.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND
BARIUM	2.0 mg/l	0.2 mg/l	0.02	0.02	0.003	0.003	ND	ND
CADMIUM	5.0 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND
CHROMIUM	0.10 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND
COPPER	[1.3] mg/l	0.02 mg/l	0.03	0.03	ND	ND	ND	ND
FLUORIDE	2.2 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND
LEAD	[15.0] ug/l	1.0 ug/l	1.1	1.1	ND	ND	ND	ND
MERCURY	2.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND
LANGLIER SATURATION INDEX	None	None	-4.51	-4.51	-5.15	-5.15	-5.41	-5.41
SELENIUM	50 ug/l	5.0 ug/l	ND	ND	ND	ND	ND	ND
SILVER	0.1 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND
SODIUM	**20/270 mg/l	0.2 mg/l	7.1	7.1	4.2	4.2	4.0	4.0
ZINC	5.0 mg/l	0.02 mg/l	0.03	0.03	ND	ND	ND	ND
COLOR	15 Units	5 Units	ND	ND	ND	ND	ND	ND
TURBIDITY	5 Units	1 Unit	ND	ND	ND	ND	ND	ND
ODOR	3 Units	0 Units	ND	ND	ND	ND	ND	ND
IRON	0.3 mg/l	0.02 mg/l	ND	ND	ND	ND	ND	ND
MANGANESE	0.3 mg/l	0.01 mg/l	ND	ND	ND	ND	ND	ND
AMMONIA	None	0.1 mg/l	ND	ND	ND	ND	ND	ND
NITRITE	1.0 mg/l	0.1 mg/l	ND	ND	ND	ND	ND	ND
NITRATE	10.0 mg/l	0.1 mg/l	4.8 <sup>(9)</sup>	4.3	2.0 <sup>(12)/1.5<sup>(7)</sup></sup>	1.7/1.4	1.2 <sup>(12)/1.5<sup>(7)</sup></sup>	0.9/1.4
CHLORIDE	250 mg/l	1.0 mg/l	11.9	11.9	5.6	5.6	7.0	7.0
TOTAL HARDNESS	None	1.0 mg/l	18.0	18.0	7.6	7.6	6.9	6.9
TOTAL ALKALINITY	None	0 mg/l	1.0 <sup>(2)</sup>	0.5	ND	ND	ND	ND
pH (BEFORE TREATMENT)	None	None	6.2 <sup>(2)</sup>	6.1	6.0	6.0	6.0	6.0
TOTAL DISSOLVED SOLIDS	None	5.0 mg/l	61.0 <sup>(2)</sup>	52.5	31.0	31.0	24.0	24.0
DETERGENTS (MBAS)	None	0.08 mg/l	ND	ND	ND	ND	ND	ND
SULFATE	250 mg/l	5.0 mg/l	ND	ND	ND	ND	ND	ND
FREE CYANIDE	200 ug/l	10.0 ug/l	ND	ND	ND	ND	ND	ND
ANTIMONY	6.0 ug/l	5.9 ug/l	ND	ND	ND	ND	ND	ND
BERYLLIUM	4.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND
CALCIUM	None	1.0 mg/l	4.5	4.5	1.7	1.7	1.5	1.5
MAGNESIUM	None	1.0 mg/l	1.7	1.7	0.8	0.8	0.8	0.8
NICKEL	0.10 mg/l	0.04 mg/l	0.003	0.003	0.001	0.001	0.001	0.001
THALLIUM	2.0 ug/l	0.3 ug/l	ND	ND	ND	ND	ND	ND
PERCHLORATE	18 ug/l	1.0 ug/l	9.5 <sup>(7)</sup>	4.1	ND	ND	5.3 <sup>(12)/ND</sup>	0.5/ND

CONT. - CONTAMINANT

ND - NOT DETECTED

\*\* - 20 mg/l IS THE LIMIT FOR PEOPLE ON HIGHLY RESTRICTED SODIUM DIETS AND 270 mg/l FOR THOSE ON MODERATELY RESTRICTED SODIUM DIETS

[ ] - USEPA/NYS DH ACTION LEVEL

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(1)</sup>		WELL NO. 1-2 N-04096 <sup>(1)</sup>		WELL NO. 2-1 N-07526 <sup>(1)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (raw/treated)	AVG. RESULT (raw/treated)	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS</b>												
<b>(SOC)</b>												
LINDANE	0.2 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
HEPTACHLOR	0.4 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ALDRIN	5.0 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
HEPTACHLOR EPOXIDE	0.2 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DIELDRIN	2.0 ug/l	0.05 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ENDRIN	2.0 ug/l	0.05 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
METHOXYCHLOR	40.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
TOXAPHENE	3.0 ug/l	2.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
CHLORDANE	2.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
TOTAL PCBs	0.5 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
PROPACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ALACHLOR	2.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
SIMAZINE	4.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ATRAZINE	3.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
METOLACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
METRIBUZIN	50.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
BUTACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND

CONT. - CONTAMINANT

NO - NOT DETECTED

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(1)</sup>		WELL NO. 4-3 N-12535 <sup>(1)</sup>		WELL NO. 5-1 N-06956 <sup>(1)</sup>		WELL NO. 5-2 N-0742		WELL NO. 5-3 N-08054	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS</b>												
<b>(SOC)</b>												
LINDANE	0.2 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
HEPTACHLOR	0.4 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
ALDRIN	5.0 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
HEPTACHLOR EPOXIDE	0.2 ug/l	0.025 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
DIELDRIN	2.0 ug/l	0.05 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
ENDRIN	2.0 ug/l	0.05 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
METHOXYCHLOR	40.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
TOXAPHENE	3.0 ug/l	2.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
CHLORDANE	2.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
TOTAL PCBs	0.5 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
PROPACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
ALACHLOR	2.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
SIMAZINE	4.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
ATRAZINE	3.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
METOLACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
METRIBUZIN	50.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED
BUTACHLOR	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED

CONT. - CONTAMINANT

ND - NOT DETECTED

NOT TESTED - STATE AND COUNTY TESTING REQUIREMENTS INCLUDE TESTING FOR SOC ONCE EVERY 18 MONTHS. THIS WELL NOT TESTED IN 2015.

(<sup>1</sup>) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595		WELL NO. 7-1 N-12670 <sup>(1)</sup>		WELL NO. 7-2 N-13923 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS</b>								
<b>(SOC)</b>								
LINDANE	0.2 ug/l	0.025 ug/l	NOT	TESTED	ND	ND	ND	ND
HEPTACHLOR	0.4 ug/l	0.025 ug/l			ND	ND	ND	ND
ALDRIN	5.0 ug/l	0.025 ug/l			ND	ND	ND	ND
HEPTACHLOR EPOXIDE	0.2 ug/l	0.025 ug/l			ND	ND	ND	ND
DIELDRIN	2.0 ug/l	0.05 ug/l			ND	ND	ND	ND
ENDRIN	2.0 ug/l	0.05 ug/l			ND	ND	ND	ND
METHOXYCHLOR	40.0 ug/l	0.25 ug/l			ND	ND	ND	ND
TOXAPHENE	3.0 ug/l	0.3 ug/l			ND	ND	ND	ND
CHLORDANE	2.0 ug/l	0.5 ug/l			ND	ND	ND	ND
TOTAL PCBs	0.5 ug/l	0.5 ug/l			ND	ND	ND	ND
PROPACHLOR	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND
ALACHLOR	2.0 ug/l	1.0 ug/l			ND	ND	ND	ND
SIMAZINE	4.0 ug/l	0.5 ug/l			ND	ND	ND	ND
ATRAZINE	3.0 ug/l	0.5 ug/l			ND	ND	ND	ND
METOLACHLOR	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND
METRIBUZIN	50.0 ug/l	0.5 ug/l			ND	ND	ND	ND
BUTACHLOR	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

NOT TESTED - STATE AND COUNTY TESTING REQUIREMENTS INCLUDE TESTING FOR SOC ONCE EVERY 18 MONTHS. THIS WELL NOT TESTED IN 2015.

(<sup>1</sup>) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(1)</sup>		WELL NO. 1-2 N-04096 <sup>(1)</sup>		WELL NO. 2-1 N-07526 <sup>(1)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (raw/treated)	AVG. RESULT (raw/treated)	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS (SOC)</b>												
<b>(CONT'D.)</b>												
2,4-D	50.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
2,4,5-TP (SILVEX)	10.0 ug/l	0.13 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DINOSEB	7.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DALAPON	200 ug/l	0.7 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
PICLORAM	500 ug/l	0.6 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DICAMBA	50.0 ug/l	0.08 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
PENTACHLOROPHENOL	1.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
HEXACHLOROCYCLOPENTADIENE	50.0 ug/l	0.64 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
bis(2-ETHYLHEXYL)ADIPATE	400 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
bis(2-ETHYLHEXYL)PHTHALATE	6.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
HEXACHLOROBENZENE	1.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
BENZO(A)PYRENE	0.2 ug/l	0.1 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ALDICARB SULFONE	2.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ALDICARBSULFOXIDE	4.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ALDICARB	3.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
TOTAL ALDICARBS	7.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
OXAMYL	200 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
METHOMYL	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
3-HYDROXYCARBOFURAN	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
CARBOFURAN	40.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
CARBARYL	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
GLYPHOSATE	700 ug/l	10.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DIQUAT	20 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
ENDOTHALL	100 ug/l	50.0 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
1,2-DIBROMOETHANE (EDB)	0.05 ug/l	0.02 ug/l	ND	ND	0.02	0.02	ND	ND	OUT OF SERVICE		ND	ND
1,2-DIBROMO-3-CHLOROPROPANE	0.2 ug/l	0.02 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DIOXIN	30 Pg/L	5.0 Pg/L	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(1)</sup>		WELL NO. 4-3 N-12535 <sup>(1)</sup>		WELL NO. 5-1 N-06956 <sup>(1)</sup>		WELL NO. 5-2 N-0742		WELL NO. 5-3 N-08054	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS (SOC)</b>												
<b>(CONT'D.)</b>												
2,4-D	50.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
2,4,5-TP (SILVEX)	10.0 ug/l	0.13 ug/l	ND	ND	ND	ND	ND	ND				
DINOSEB	7.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND				
DALAPON	200 ug/l	0.7 ug/l	ND	ND	ND	ND	ND	ND				
PICLORAM	500 ug/l	0.6 ug/l	ND	ND	ND	ND	ND	ND				
DICAMBA	50.0 ug/l	0.08 ug/l	ND	ND	ND	ND	ND	ND				
PENTACHLOROPHENOL	1.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND				
HEXACHLOROCYCLOPENTADIENE	50.0 ug/l	0.64 ug/l	ND	ND	ND	ND	ND	ND				
bis(2-ETHYLHEXYL)ADIPATE	400 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
bis(2-ETHYLHEXYL)PHTHALATE	6.0 ug/l	3.0 ug/l	ND	ND	ND	ND	ND	ND				
HEXACHLOROENZENE	1.0 ug/l	0.25 ug/l	ND	ND	ND	ND	ND	ND				
BENZO(A)PYRENE	0.2 ug/l	0.1 ug/l	ND	ND	ND	ND	ND	ND				
ALDICARB SULFONE	2.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
ALDICARBSULFOXIDE	4.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
ALDICARB	3.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
TOTAL ALDICARBS	7.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
OXAMYL	200 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
METHOMYL	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
3-HYDROXYCARBOFURAN	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
CARBOFURAN	40.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
CARBARYL	50.0 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
GLYPHOSATE	700 ug/l	10.0 ug/l	ND	ND	ND	ND	ND	ND				
DIQUAT	20 ug/l	1.0 ug/l	ND	ND	ND	ND	ND	ND				
ENDOTHALL	100 ug/l	50.0 ug/l	ND	ND	ND	ND	ND	ND				
1,2-DIBROMOETHANE (EDB)	0.05 ug/l	0.02 ug/l	ND	ND	ND	ND	ND	ND				
1,2-DIBROMO-3-CHLOROPROPANE	0.2 ug/l	0.02 ug/l	ND	ND	ND	ND	ND	ND				
DIOXIN	30 Pg/L	5.0 Pg/L	ND	ND	ND	ND	ND	ND				

CONT. - CONTAMINANT

ND - NOT DETECTED

NOT TESTED - STATE AND COUNTY TESTING REQUIREMENTS INCLUDE TESTING FOR SOC ONCE EVERY 18 MONTHS. THIS WELL NOT TESTED IN 2015.

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

**PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)**

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595		WELL NO. 7-1 N-12670 <sup>(1)</sup>		WELL NO. 7-2 N-13923 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>SYNTHETIC ORGANICS CONTAMINANTS (SOC)</b>								
<b>(CONT'D.)</b>								
2,4-D	50.0 ug/l	0.3 ug/l	NOT	TESTED	ND	ND	ND	ND
2,4,5-TP (SILVEX)	10.0 ug/l	0.13 ug/l			ND	ND	ND	ND
DINOSEB	7.0 ug/l	0.2 ug/l			ND	ND	ND	ND
DALAPON	200 ug/l	0.7 ug/l			ND	ND	ND	ND
PICLORAM	500 ug/l	0.6 ug/l			ND	ND	ND	ND
DICAMBA	50.0 ug/l	0.08 ug/l			ND	ND	ND	ND
PENTACHLOROPHENOL	1.0 ug/l	0.2 ug/l			ND	ND	ND	ND
HEXACHLOROCYCLOPENTADIENE	50.0 ug/l	0.64 ug/l			ND	ND	ND	ND
bis(2-ETHYLHEXYL)ADIPATE	400 ug/l	1.0 ug/l			ND	ND	ND	ND
bis(2-ETHYLHEXYL)PHTHALATE	6.0 ug/l	3.0 ug/l			ND	ND	ND	ND
HEXACHLOROBENZENE	1.0 ug/l	0.25 ug/l			ND	ND	ND	ND
BENZO(A)PYRENE	0.2 ug/l	0.1 ug/l			ND	ND	ND	ND
ALDICARB SULFONE	2.0 ug/l	1.0 ug/l			ND	ND	ND	ND
ALDICARBSULFOXIDE	4.0 ug/l	1.0 ug/l			ND	ND	ND	ND
ALDICARB	3.0 ug/l	1.0 ug/l			ND	ND	ND	ND
TOTAL ALDICARBS	7.0 ug/l	1.0 ug/l			ND	ND	ND	ND
OXAMYL	200 ug/l	1.0 ug/l			ND	ND	ND	ND
METHOMYL	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND
3-HYDROXYCARBOFURAN	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND
CARBOFURAN	40.0 ug/l	1.0 ug/l			ND	ND	ND	ND
CARBARYL	50.0 ug/l	1.0 ug/l			ND	ND	ND	ND
GLYPHOSATE	700 ug/l	10.0 ug/l			ND	ND	ND	ND
DIQUAT	20 ug/l	1.0 ug/l			ND	ND	ND	ND
ENDOTHALL	100 ug/l	50.0 ug/l			ND	ND	ND	ND
1,2-DIBROMOETHANE (EDB)	0.05 ug/l	0.02 ug/l			ND	ND	ND	ND
1,2-DIBROMO-3-CHLOROPROPANE	0.2 ug/l	0.02 ug/l			ND	ND	ND	ND
DIOXIN	30 Pg/L	5.0 Pg/L			ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

NOT TESTED - STATE AND COUNTY TESTING REQUIREMENTS INCLUDE TESTING FOR SOC ONCE EVERY 18 MONTHS. THIS WELL NOT TESTED IN 2015.

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(12)</sup>		WELL NO. 1-2 N-04096 <sup>(2)</sup>		WELL NO. 2-1 N-07526 <sup>(24)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(13)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>TRIHALOMETHANES AND HALOACETIC ACIDS</b>												
CHLOROACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
BROMOACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
DICHLOROACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
TRICHLOROACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
DIBROMOACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
TOTAL HALOACETIC ACID	60 ug/l	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		NOT TESTED	NOT TESTED
CHLOROFORM	50 ug/l	< 0.5 ug/l	0.6	0.1	0.5/ND	0.5/ND	1.4/ND	1.1/ND	OUT OF SERVICE		ND	ND
BROMODICHLOROMETHANE	50 ug/l	< 0.5 ug/l	1.2	0.2	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
DIBROMOCHLOROMETHANE	50 ug/l	< 0.5 ug/l	2.2	0.3	ND	ND	ND/1.1	ND/0.1	OUT OF SERVICE		ND	ND
BROMOFORM	50 ug/l	< 0.5 ug/l	1.9	0.3	ND	ND	ND/1.3	ND/0.1	OUT OF SERVICE		ND	ND
TOTAL TRIHALOMETHANES	80 ug/l	< 1.0 ug/l	5.9	0.7	ND	ND	ND/2.4	ND/0.2	OUT OF SERVICE		ND	ND
<b>RADIONUCLIDES</b>												
GROSS ALPHA	15 pCi/L	< 3 pCi/L	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	1.22 <sup>(1)</sup>	1.22	OUT OF SERVICE		1.13 <sup>(1)</sup>	1.13
GROSS BETA	50 pCi/L	< 3 pCi/L	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	1.97 <sup>(1)</sup>	1.97	OUT OF SERVICE		3.44 <sup>(1)</sup>	3.44
RADIUM 226	5 pCi/L	< 3 pCi/L	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	0.778 <sup>(1)</sup>	0.778	OUT OF SERVICE		1.74 <sup>(2)</sup>	1.24
RADIUM 228	5 pCi/L	< 3 pCi/L	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	1.02 <sup>(1)</sup>	1.02	OUT OF SERVICE		1.77 <sup>(2)</sup>	1.66
TOTAL URANIUM	30 ug/l	< 3.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	OUT OF SERVICE		ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

pCi/L - pico Curies per Liter

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(25)</sup>		WELL NO. 4-3 N-12535 <sup>(25)</sup>		WELL NO. 5-1 N-06956 <sup>(18)</sup>		WELL NO. 5-2 N-07421 <sup>(22)</sup>		WELL NO. 5-3 N-08054 <sup>(22)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	ND RESULT (Raw/Treat)	ND RESULT (Raw/Treat)
<b>TRIHALOMETHANES AND HALOACETIC ACIDS</b>												
CHLOROACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
BROMOACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
DICHLOROACETIC ACID	---	0.3 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
TRICHLOROACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
DIBROMOACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
TOTAL HALOACETIC ACID	60 ug/l	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
CHLOROFORM	50 ug/l	< 0.5 ug/l	0.6/ND	0.1/ND	ND	ND	ND	ND	2.1/ND	0.3/ND	2.9/ND	1.0/ND
BROMODICHLOROMETHANE	50 ug/l	< 0.5 ug/l	ND	ND	ND	ND	ND	ND	1.1/ND	0.2/ND	1.54/ND	0.2/ND
DIBROMOCHLOROMETHANE	50 ug/l	< 0.5 ug/l	ND	ND	ND	ND	ND	ND	0.6/ND	0.1/ND	0.9/ND	0.1/ND
BROMOFORM	50 ug/l	< 0.5 ug/l	1.5/ND	0.1/ND	ND	ND	ND	ND	ND	ND	2.0/ND	0.3/ND
TOTAL TRIHALOMETHANES	80 ug/l	< 1.0 ug/l	ND	ND	ND	ND	ND	ND	3.9/ND	0.6/ND	7.3/ND	1.1/ND
<b>RADIONUCLIDES</b>												
GROSS ALPHA	15 pCi/L	< 3 pCi/L	0.64 <sup>(2)</sup>	0.5595	1.13 <sup>(1)</sup>	1.13	1.48 <sup>(1)</sup>	1.48	2.62 <sup>(1)</sup>	2.62	2.20 <sup>(1)</sup>	2.20
GROSS BETA	50 pCi/L	< 3 pCi/L	1.2 <sup>(2)</sup>	1.0875	1.33 <sup>(1)</sup>	1.33	2.24 <sup>(1)</sup>	2.24	2.08 <sup>(1)</sup>	2.08	2.36 <sup>(1)</sup>	2.36
RADIUM 226	5 pCi/L	< 3 pCi/L	0.579 <sup>(3)</sup>	0.46	0.52 <sup>(2)</sup>	0.30	1.31 <sup>(1)</sup>	1.31	0.971 <sup>(1)</sup>	0.971	1.49 <sup>(1)</sup>	1.49
RADIUM 228	5 pCi/L	< 3 pCi/L	2.15 <sup>(3)</sup>	1.45	0.973 <sup>(2)</sup>	0.96	1.12 <sup>(1)</sup>	1.12	2.18 <sup>(1)</sup>	2.18	0.594 <sup>(1)</sup>	0.594
TOTAL URANIUM	30 ug/l	< 3.0 ug/l	ND	ND	ND	ND	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED

ND - NOT DETECTED

pCi/L - pico Curies per Liter

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595 <sup>(6)</sup>		WELL NO. 7-1 N-12670 <sup>(24)</sup>		WELL NO. 7-2 N-13923 <sup>(24)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>TRIHALOMETHANES AND HALOACETIC ACIDS</b>								
CHLOROACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
BROMOACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
DICHLOROACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
TRICHLOROACETIC ACID	---	< 1.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
DIBROMOACETIC ACID	---	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
TOTAL HALOACETIC ACID	60 ug/l	< 2.0 ug/l	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED
CHLOROFORM	50 ug/l	< 0.5 ug/l	1.1	0.9	8.4/ND	5.4/ND	5.5/ND	3.2/ND
BROMODICHLOROMETHANE	50 ug/l	< 0.5 ug/l	ND	ND	ND/0.5	ND/0.1	ND/0.5	ND/0.1
DIBROMOCHLOROMETHANE	50 ug/l	< 0.5 ug/l	ND	ND	ND/0.5	ND/0.1	ND/0.5	ND/0.1
BROMOFORM	50 ug/l	< 0.5 ug/l	ND	ND	ND	ND	ND	ND
TOTAL TRIHALOMETHANES	80 ug/l	< 1.0 ug/l	ND	ND	8.4/ND	5.2/ND	5.5/ND	2.9/ND
<b>RADIONUCLIDES</b>								
GROSS ALPHA	15 pCi/L	< 3 pCi/L	2.74 <sup>(1)</sup>	2.74	1.33 <sup>(1)</sup>	1.33	0.465 <sup>(1)</sup>	0.465
GROSS BETA	50 pCi/L	< 3 pCi/L	2.70 <sup>(1)</sup>	2.70	1.51 <sup>(1)</sup>	1.51	-0.921 <sup>(1)</sup>	-0.921
RADIUM 226	5 pCi/L	< 3 pCi/L	1.32 <sup>(2)</sup>	1.1425	0.357 <sup>(1)</sup>	0.357	0.0608 <sup>(1)</sup>	0.0608
RADIUM 228	5 pCi/L	< 3 pCi/L	1.66 <sup>(1)</sup>	1.425	1.68 <sup>(1)</sup>	1.68	0.734 <sup>(1)</sup>	0.734
TOTAL URANIUM	30 ug/l	< 3.0 ug/l	0.008 <sup>(1)</sup>	0.008	NOT TESTED	NOT TESTED	NOT TESTED	NOT TESTED

CONT. - CONTAMINANT

ND - NOT DETECTED

pCi/L - pico Curies per Liter

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095		WELL NO. 1-2 N-04096		WELL NO. 2-1 N-07526		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(1)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>UCMR3</b>												
1,4 DIOXANE	50 ug/l	0.7 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		OUT OF SERVICE		1.0 <sup>(1)</sup>	1.0
<b>VOLATILES</b>												
1,1-DICHLOROETHANE	5.0 ug/l	0.03 ug/l	3.0 <sup>(12)</sup>	1.9	3.0 <sup>(1)</sup> /ND	3.0/ND	4.6 <sup>(12)</sup> /ND	3.8/ND			1.9 <sup>(7)</sup> /0.7	1.5/0.3
1,2,3-TRICHLORPROPANE	5.0 ug/l	0.03 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,3-BUTADIENE	50 ug/l	0.1 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
BROMOCHLOROMETHANE	50 ug/l	0.06 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BROMOMETHANE	5.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CHLORODIFLUOROMETHANE	5.0 ug/l	0.08 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CHLOROMETHANE	5.0 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
<b>PERFLUORO CHEMICALS</b>												
PERFLUOROBUTANESULFONIC ACID	5.0 ug/l	0.9 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
PERFLUOROHEPTANOIC ACID	5.0 ug/l	0.01 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
PERFLUOROHEXANESULFONIC ACID	5.0 ug/l	0.03 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
PERFLUORONONANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
PERFLUOROOCETANESULFONIC ACID	5.0 ug/l	0.04 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
PERFLUOROOCETANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
<b>METALS</b>												
CHROMIUM	100 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
COBALT		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
MOLYBDENUM		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
STRONTIUM		0.3 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
VANADIUM		0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
HEXAVALENT CHROMIUM		0.03 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
CHLORATE		20 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
<b>HORMONES</b>												
17-ALPHA-ETHINYLESTRADIOL	50 ug/l	0.0004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
17-BETA-ESTRADIOL	50 ug/l	0.0009 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
4-ANDROSTENE-3,17-DIONE	50 ug/l	0.0003 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
EQUILIN	50 ug/l	0.004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
ESTRIOL	50 ug/l	0.0008 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
ESTRONE	50 ug/l	0.002 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	
TESTOSTERONE	50 ug/l	0.0001 ug/l	NOT TESTED		NOT TESTED		NOT TESTED				NOT TESTED	

CONT. - CONTAMINANT

ND - NOT DETECTED

WELL NO. 3-1 - OUT OF SERVICE

(<sup>1</sup>) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(1)</sup>		WELL NO. 4-3 N-12535 <sup>(3)</sup>		WELL NO. 5-1 N-06956		WELL NO. 5-2 N-07421 <sup>(1)</sup>		WELL NO. 5-3 N-08054 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>UCMR3</b>												
1,4 DIOXANE	50 ug/l	0.7 ug/l	2.8	2.8	0.59	0.59	NOT TESTED		NOT TESTED		NOT TESTED	
<b>VOLATILES</b>												
1,1-DICHLOROETHANE	5.0 ug/l	0.03 ug/l	***7.3 <sup>(13)</sup> /ND	4.4/ND	1.1 <sup>(13)</sup> /ND	0.8/ND	0.7 <sup>(8)</sup> /ND	0.5/ND	0.7 <sup>(7)</sup> /ND	0.4/ND	3.0 <sup>(7)</sup> /ND	1.8/ND
1,2,3-TRICHLORPROPANE	5.0 ug/l	0.03 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-BUTADIENE	50 ug/l	0.1 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
BROMOCHLOROMETHANE	50 ug/l	0.06 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BROMOMETHANE	5.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLORODIFLUOROMETHANE	5.0 ug/l	0.08 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLOROMETHANE	5.0 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
<b>PERFLUORO CHEMICALS</b>												
PERFLUOROBUTANESULFONIC ACID	5.0 ug/l	0.9 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROHEPTANOIC ACID	5.0 ug/l	0.01 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROHXANESULFONIC ACID	5.0 ug/l	0.03 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUORONONANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROOCTANESULFONIC ACID	5.0 ug/l	0.04 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROOCTANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
<b>METALS</b>												
CHROMIUM	100 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
COBALT		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
MOLYBDENUM		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
STRONTIUM		0.3 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
VANADIUM		0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
HEXAVALENT CHROMIUM CHLORATE		0.03 ug/l 20 ug/l	NOT TESTED NOT TESTED		NOT TESTED NOT TESTED		NOT TESTED NOT TESTED		NOT TESTED NOT TESTED		NOT TESTED NOT TESTED	
<b>HORMONES</b>												
17-ALPHA-ETHYNYLESTRADIOL	50 ug/l	0.0004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
17-BETA-ESTRADIOL	50 ug/l	0.0009 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
4-ANDROSTENE-3,17-DIONE	50 ug/l	0.0003 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
EQUILIN	50 ug/l	0.004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
ESTRIOL	50 ug/l	0.0008 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
ESTRONE	50 ug/l	0.002 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	
TESTOSTERONE	50 ug/l	0.0001 ug/l	NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED		NOT TESTED	

CONT. - CONTAMINANT

NO - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT LIMITS	WELL NO. 5-4 N-08595 <sup>(1)</sup>		WELL NO. 7-1 N-12670 <sup>(1)</sup>		WELL NO. 7-2 N-13923 <sup>(1)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT	MAX. RESULT	AVG. RESULT
<b>UCMR3</b>								
1,4 DIOXANE	50 ug/l	0.7 ug/l	0.78	0.78	NOT TESTED		NOT TESTED	
<b>VOLATILES</b>								
1,1-DICHLOROETHANE	5.0 ug/l	0.03 ug/l	1.7 <sup>(8)</sup>	1.3	1.1 <sup>(12)</sup> /ND	0.6/ND	2.2 <sup>(12)</sup> /ND	1.5/ND
1,2,3-TRICHLORPROPANE	5.0 ug/l	0.03 ug/l	ND	ND	ND	ND	ND	ND
1,3-BUTADIENE	50 ug/l	0.1 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
BROMOCHLOROMETHANE	50 ug/l	0.06 ug/l	ND	ND	ND	ND	ND	ND
BROMOMETHANE	5.0 ug/l	0.2 ug/l	ND	ND	ND	ND	ND	ND
CHLORODIFLUOROMETHANE	5.0 ug/l	0.08 ug/l	ND	ND	ND	ND	ND	ND
CHLOROMETHANE	5.0 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
<b>PERFLUOROCEMICALS</b>								
PERFLUOROBUTANESULFONIC ACID	5.0 ug/l	0.9 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROHEPTANOIC ACID	5.0 ug/l	0.01 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROHXANESULFONIC ACID	5.0 ug/l	0.03 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUORONONANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROCTANESULFONIC ACID	5.0 ug/l	0.04 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
PERFLUOROCTANOIC ACID	5.0 ug/l	0.02 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
<b>METALS</b>								
CHROMIUM	100 ug/l	0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
COBALT		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
MOLYBDENUM		1.0 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
STRONTIUM		0.3 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
VANADIUM		0.2 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
HEXAVALENT CHROMIUM		0.03 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
CHLORATE		20 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
<b>HORMONES</b>								
17-ALPHA-ETHNYLESTRADIOL	50 ug/l	0.0004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
17-BETA-ESTRADIOL	50 ug/l	0.0009 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
4-ANDROSTENE-3,17-DIONE	50 ug/l	0.0003 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
EQUILIN	50 ug/l	0.004 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
ESTRIOL	50 ug/l	0.0008 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
ESTRONE	50 ug/l	0.002 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	
TESTOSTERONE	50 ug/l	0.0001 ug/l	NOT TESTED		NOT TESTED		NOT TESTED	

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(12)</sup>		WELL NO. 1-2 N-04096 <sup>(2)</sup>		WELL NO. 2-1 N-07526 <sup>(24)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(13)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>VOLATILE ORGANICS</b>												
DICHLORODIFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE		ND	ND
CHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
VINYL CHLORIDE	2.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
TRICHLOROFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,1-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	2.1	1.1	1.0/ND	1.0/ND	***17.1/ND	***14.7/ND			0.9/ND	0.6/ND
METHYLENE CHLORIDE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
TRANS-1,2-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,1-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	3.0	1.9	3.0/ND	3.0/ND	4.6/ND	3.8/ND			1.9/0.7	1.5/0.3
cis -1,2 DICHLOROETHENE	5.0 ug/l	0.5 ug/l	2.1	0.9	1.6/ND	1.6/ND	3.2/ND	2.5/ND			***14.7/1.8	***9.3/1.0
2,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BROMOCHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,1,1-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	2.2	0.9	1.6/ND	1.8/ND	***10.3/ND	***9.2/ND			1.4/ND	0.4/ND
CARBON TETRACHLORIDE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	1.7/ND	0.4/ND			ND	ND
1,1-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	0.6/ND	0.6/ND	0.7/ND	0.4/ND			ND	ND
TRICHLOROETHENE	5.0 ug/l	0.5 ug/l	1.2	0.5	0.8/ND	0.8/ND	***39.2/ND	***23.5/ND			2.6/ND	2.0/ND
1,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2-DIBROMOETHANE	5.0 ug/l	0.5 ug/l	0.02	0.01	0.02/ND	0.02/ND	ND	ND			ND	ND
DIBROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
TRANS-1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	1.0/ND	0.1/ND			ND	ND
cis -1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	1.0/ND	0.1/ND			ND	ND
1,1,2-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
TETRACHLOROETHENE	5.0 ug/l	0.5 ug/l	2.3	0.9	4.7/ND	4.7/ND	***8.7/ND	***7.1/ND			***50.7/ND	***27.7/ND

CONT. - CONTAMINANT

ND - NOT DETECTED

\*\*\* - EXCEEDS NEW YORK STATE/USEPA LIMITS FOR POTABLE WATER

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT LIMITS	WELL NO. 1-1 N-04095 <sup>(12)</sup>		WELL NO. 1-2 N-04096 <sup>(2)</sup>		WELL NO. 2-1 N-07526 <sup>(24)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(13)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>VOLATILE ORGANICS (CONT'D.)</b>									OUT OF SERVICE			
1,3-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
CHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,1,1,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BROMOBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,1,2,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2,3-TRICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
2-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
4-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,3-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,4-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2,4-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
HEXACHLOROBUTADIENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,2,3-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
BENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
TOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
ETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
M,P-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
O-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
STYRENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
ISOPROPYLBENZENE (CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
N-PROPYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND
1,3,5-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND			ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

WELL NO. 1-1 - OUT OF SERVICE DURING 2009

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 1-1 N-04095 <sup>(12)</sup>		WELL NO. 1-2 N-04096 <sup>(2)</sup>		WELL NO. 2-1 N-07526 <sup>(24)</sup>		WELL NO. 3-1 N-04097		WELL NO. 3-2 N-06580 <sup>(13)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>VOLATILE ORGANICS (CONT'D.)</b>												
TERT-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	OUT OF SERVICE	ND	ND	ND
1,2,4-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND		ND	ND	ND
SEC-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND		ND	ND	ND
4-ISOPROPYLTOLUENE (P-CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND		ND	ND	ND
N-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND		ND	ND	ND
METHYL TERT.BUTYL ETHER (MTBE)	10.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND		ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

WELL NO. 1-1 - OUT OF SERVICE DURING 2009

WELL NO. 3-1 - OUT OF SERVICE

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(25)</sup>		WELL NO. 4-3 N-12535 <sup>(25)</sup>		WELL NO. 5-1 N-06956 <sup>(18)</sup>		WELL NO. 5-2 N-07421 <sup>(22)</sup>		WELL NO. 5-3 N-08054 <sup>(22)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	ND RESULT (Raw/Treat)	ND RESULT (Raw/Treat)						
<b>VOLATILE ORGANICS</b>												
DICHLORODIFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
VINYL CHLORIDE	2.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TRICHLOROFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	2.6/ND	1.3/ND	ND	ND	ND	ND	0.5/ND	0.1/ND	1.1/ND	0.8/ND
METHYLENE CHLORIDE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TRANS-1,2-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	***7.3/ND	4.4/ND	1.1/ND	0.8/ND	0.7/ND	0.5/ND	0.7/ND	0.4/ND	3.0/ND	1.8/ND
<i>cis</i> -1,2-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	0.6/ND	0.1/ND	ND	ND	ND	ND	0.7/ND	0.1/ND	2.2/ND	1.2/ND
2,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BROMOCHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	2.4/ND	1.1/ND	1.3/ND	0.1/ND	ND	ND	0.7/ND	0.3/ND	1.7/ND	1.1/ND
CARBON TETRACHLORIDE	5.0 ug/l	0.5 ug/l	2.0/ND	0.2/ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-DIBROMOETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TRICHLOROETHENE	5.0 ug/l	0.5 ug/l	***5.5/ND	2.8/ND	ND	ND	0.6/ND	0.2/ND	ND	ND	2.3/ND	1.4/ND
1,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	0.6/ND	0.2/ND
DIBROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TRANS-1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
<i>cis</i> -1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TETRACHLOROETHENE	5.0 ug/l	0.5 ug/l	***9.6/ND	***5.8/ND	ND	ND	ND	ND	ND	ND	0.5/ND	0.2/ND

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-06077 <sup>(25)</sup>		WELL NO. 4-3 N-12535 <sup>(25)</sup>		WELL NO. 5-1 N-06956 <sup>(18)</sup>		WELL NO. 5-2 N-07421 <sup>(22)</sup>		WELL NO. 5-3 N-08054 <sup>(22)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	ND RESULT (Raw/Treat)	ND RESULT (Raw/Treat)						
<b>VOLATILE ORGANICS (CONT'D.)</b>		0.3 ug/l										
1,3-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BROMOBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3-TRICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
HEXACHLOROBUTADIENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,3-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
BENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
TOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
ETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
M,P-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
O-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
STYRENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
ISOPROPYLBENZENE (CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-PROPYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3,5-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 4-2 N-0607 <sup>(25)</sup>		WELL NO. 4-3 N-12535 <sup>(25)</sup>		WELL NO. 5-1 N-06956 <sup>(18)</sup>		WELL NO. 5-2 N-07421 <sup>(22)</sup>		WELL NO. 5-3 N-08054 <sup>(22)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	ND RESULT (Raw/Treat)	ND RESULT (Raw/Treat)
<b>VOLATILE ORGANICS (CONT'D.)</b>												
TERT-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
SEC-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-ISOPROPYLTOLUENE (P-CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
N-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
METHYL TERT.BUTYL ETHER (MTBE)	10.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595 <sup>(6)</sup>		WELL NO. 7-1 N-12670 <sup>(24)</sup>		WELL NO. 7-2 N-13923 <sup>(24)</sup>	
			MAX. RESULT	AVG. RESULT	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>VOLATILE ORGANICS</b>								
DICHLORODIFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
CHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
VINYL CHLORIDE	2.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
BROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
CHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TRICHLOROFLUOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	1.1/ND	0.1/ND
1,1-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	0.7	0.5/ND	5.8/ND	3.3/ND	***9.0/ND	***6.1/ND
METHYLENE CHLORIDE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TRANS-1,2-DICHLOROETHENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,1-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	1.7	1.3	1.1/ND	0.6/ND	2.2/ND	1.5/ND
<i>cis</i> -1,2 DICHLOROETHENE	5.0 ug/l	0.5 ug/l	ND	ND	3.1/ND	1.5/ND	***8.5/ND	***5.4/ND
2,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
BROMOCHLOROMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,1,1-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	1.5	0.8	***8.6/ND	4.8/ND	***9.3/ND	***7.0/ND
CARBON TETRACHLORIDE	5.0 ug/l	0.5 ug/l	ND	ND	2.7/ND	0.3/ND	1.2/ND	0.3/ND
1,1-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2-DICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TRICHLOROETHENE	5.0 ug/l	0.5 ug/l	1.0	0.8	***98.8/2.3	***62.3/0.9	***246.0/2.3	***132.9/0.9
1,2-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2-DIBROMOETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
DIBROMOMETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TRANS-1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
<i>cis</i> -1,3-DICHLOROPROPENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,1,2-TRICHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TETRACHLOROETHENE	5.0 ug/l	0.5 ug/l	ND	ND	***44.3/0.7	***15.7/0.1	***243.0/0.7	***107.1/0.1

CONT. - CONTAMINANT

ND - NOT DETECTED

\*\*\* - EXCEEDS NEW YORK STATE/USEPA LIMITS FOR POTABLE WATER

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08895 <sup>(9)</sup>		WELL NO. 7-1 N-12670 <sup>(24)</sup>		WELL NO. 7-2 N-13923 <sup>(24)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b><u>VOLATILE ORGANICS (CONT'D.)</u></b>								
1,3-DICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
CHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,1,1,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
BROMOBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,1,2,2-TETRACHLOROETHANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2,3-TRICHLOROPROPANE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
2-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
4-CHLOROTOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,3-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,4-DICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2,4-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
HEXACHLOROBUTADIENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2,3-TRICHLOROBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
BENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
TOLUENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
ETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
M,P-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
O-XYLENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
STYRENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
ISOPROPYLBENZENE (CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
N-PROPYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,3,5-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR

PLAINVIEW WATER DISTRICT  
2015 WATER QUALITY DATA (continued)

PARAMETERS (ug/l)	MAX. CONT. LEVEL	DETECT. LIMITS	WELL NO. 5-4 N-08595 <sup>(6)</sup>		WELL NO. 7-1 N-12670 <sup>(24)</sup>		WELL NO. 7-2 N-13923 <sup>(24)</sup>	
			MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)	MAX. RESULT (Raw/Treat)	AVG. RESULT (Raw/Treat)
<b>VOLATILE ORGANICS (CONT'D.)</b>								
TERT-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
1,2,4-TRIMETHYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
SEC-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
4-ISOPROPYLTOLUENE (P-CUMENE)	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
N-BUTYLBENZENE	5.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND
METHYL TERT.BUTYL ETHER (MTBE)	10.0 ug/l	0.5 ug/l	ND	ND	ND	ND	ND	ND

CONT. - CONTAMINANT

ND - NOT DETECTED

( ) - NUMBER OF SAMPLES COLLECTED AND TESTED DURING THE YEAR